






OUTLINE AND  
INSTALLATION  
CUTOUT TEMPLATE  
  
BEFORE USING  
VERIFY ACCURACY

WARM AIR RETURN

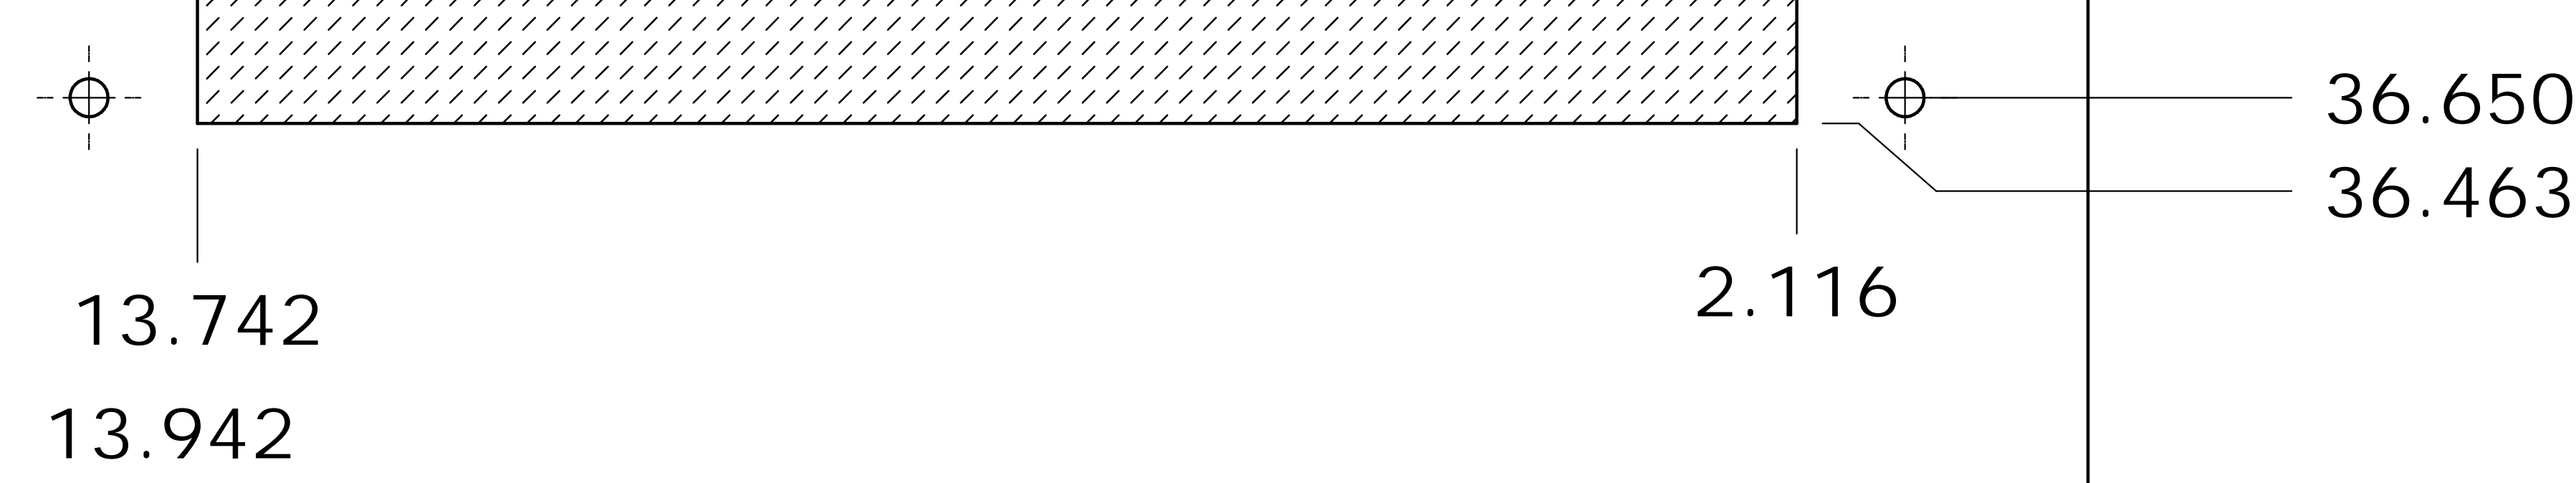

COLD AIR DISCHARGE  
(ANGLED DOWNWARD)

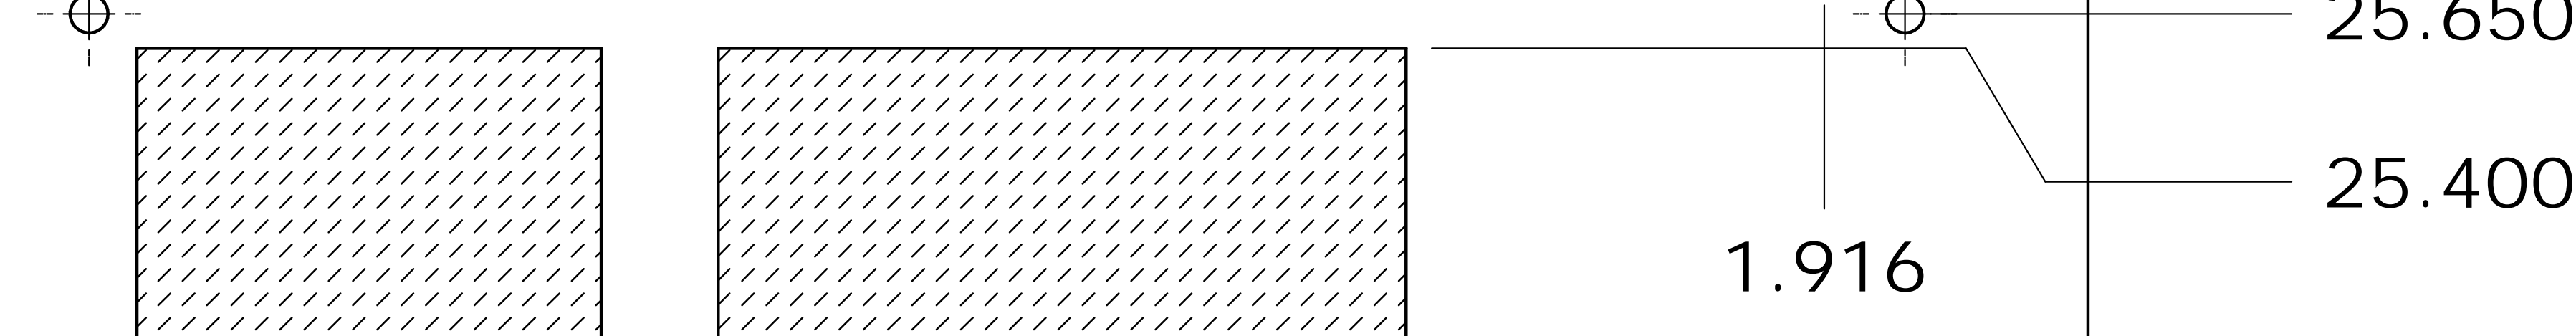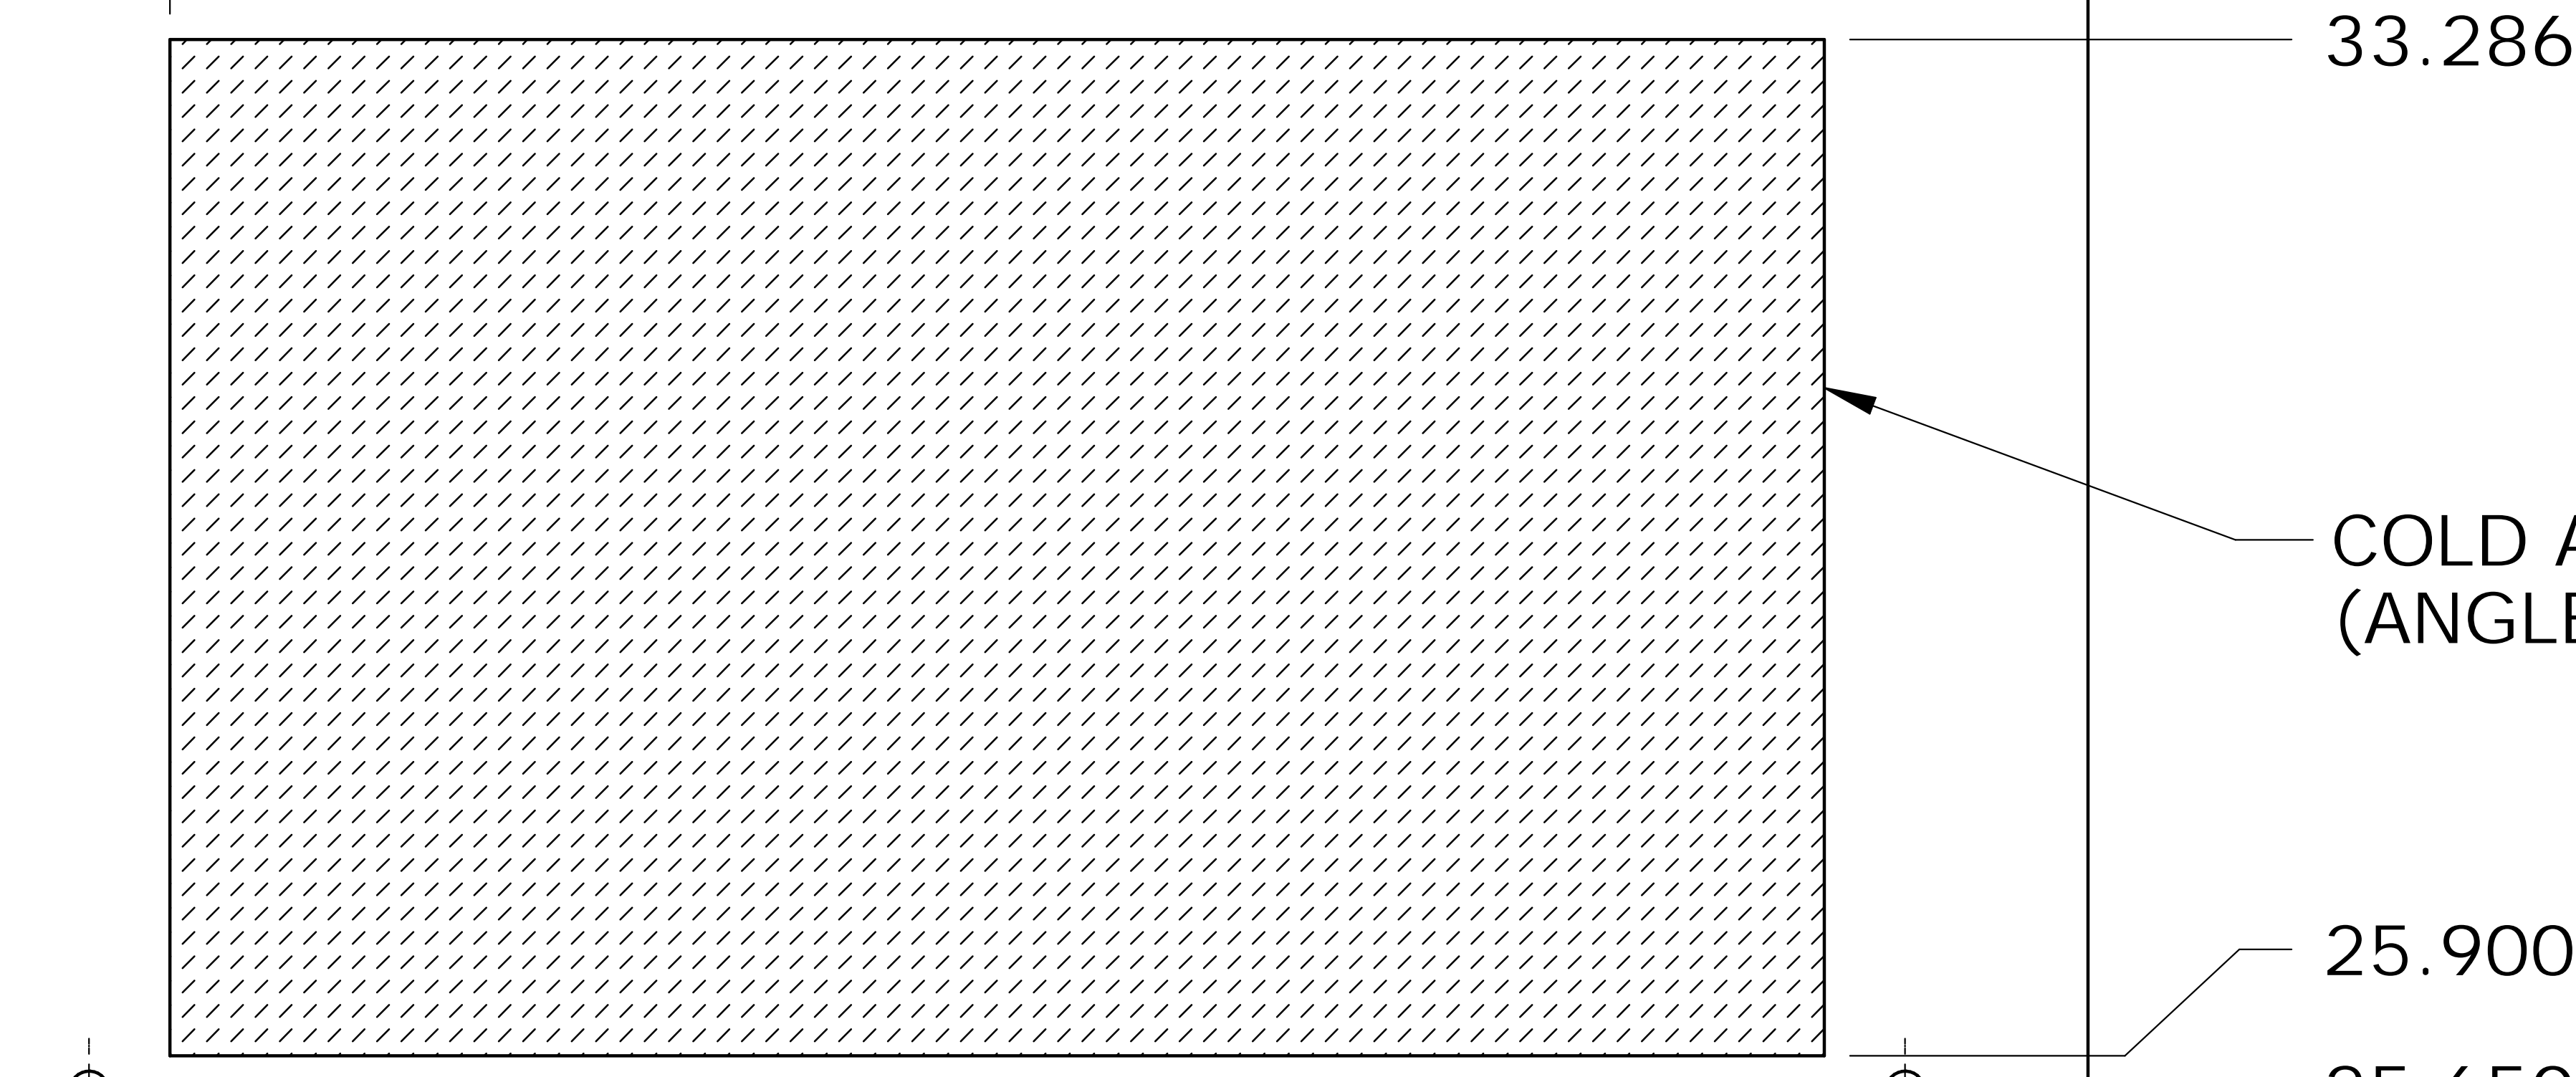

THIS CUTOUT SERVICES  
POWER CORD AND ALL  
OPTIONAL FEATURES.  
  
THIS CUTOUT SERVICES  
POWER INPUT TERMINAL  
BLOCK AND IS NOT REQ'D  
FOR CORDED MODELS

L  
E  
F  
T

R  
I  
G  
H  
T

VIEW IS FROM AMBIENT SIDE,  
OUTSIDE ENCLOSURE.  
OPPOSITE SIDE OF THIS  
TEMPLATE IS TOWARD  
ENCLOSURE.



INSTALLATION TEMPLATE FOR  
HC101 (115 AND 230V) 10,000 BTU/H,  
HC121 (115 AND 230V) 12,000 BTU/H,  
HC151 (230V ONLY) 15,000 BTU/H,  
HC20C (230V ONLY) 20,000 BTU/H  
INCLUDING ALL ELECTRIC FEATURES AND OPTIONS